
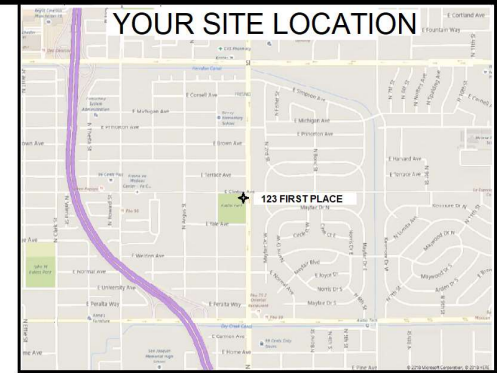



FIRST PLACE

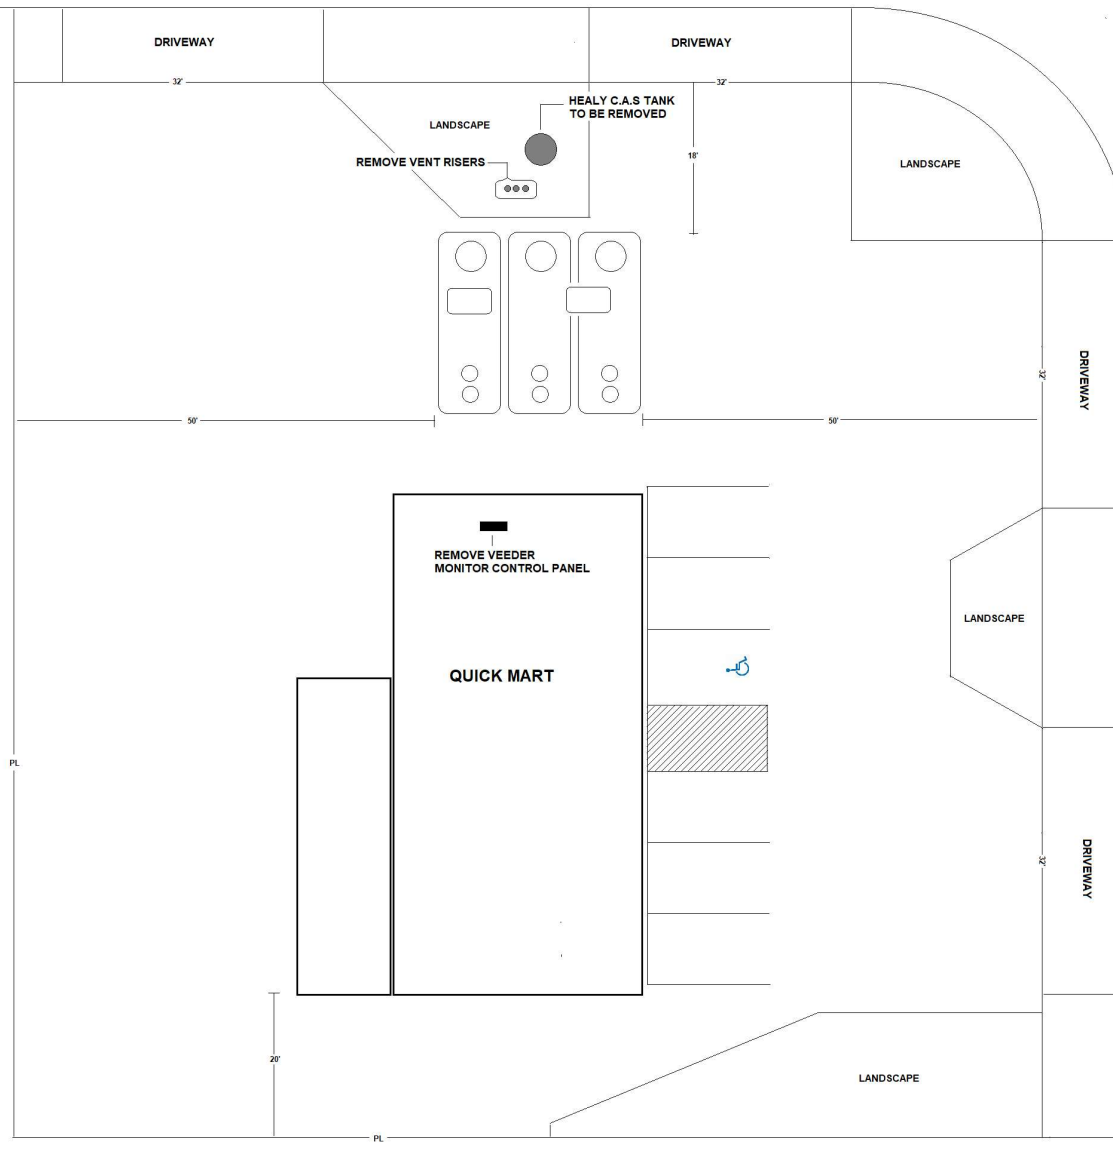

SCOPE OF WORK:

- REMOVAL AND CLOSURE OF THREE (3) 8,000 GALLON UNDERGROUND STORAGE FUEL TANKS (USTS)
 - REMOVE THE (3) UST'S, ASSOCIATED PIPING, (1) HEALY C.A.S. TANK AND (2) DISPENSERS. DISPOSE OF
 - PROVIDE THE REQUIRED SOILS TESTING AND DISPOSAL OF THE RINSE WATER WASTE PER STATE WATER RESOURCES CONTROL BOARD, FIRE DEPARTMENT, AND HEALTH SERVICE DEPARTMENT REQUIREMENTS.
 - ONCE FINAL RESULTS OF SOILS TESTS ARE COMPLETED, SUBMIT CLOSURE REPORT TO COUNTY AND FIRE DEPARTMENT.
1. MARK LOCATION OF UTILITIES
 2. NOTIFICATION OF DIG ALERT BEFORE EXCAVATION
 3. SET UP TEMPORARY FENCING AND BARRICADES AS REQUIRED.
 4. SAW CUT, DEMO CONCRETE, AND ASPHALT ABOVE THE TANK PIT. THE DEMO AREA SHALL NOT EXCEED 40 FEET IN LENGTH BY 30 FEET WIDE BY 10' FEET DEEP FOR TANK REMOVAL
 5. EXCAVATE (3) UST'S AND STOCKPILE SOIL ONSITE ACCORDING TO AREA AIR QUALITY DISTRICT REQUIREMENTS.
 6. FLUSH ALL PRODUCT, VAPOR AND VENT LINES BACK TO TANKS. PUMP (3) UST'S OF REMAINING PRODUCT AND REMOVE SLUDGE
 7. WASH (3) UST'S WITH RINSE LIQUID, AND DISPOSE OF REINSTATE BY PERMITTED HAULER TO PERMITTED RECYCLER/DUMPSITE
 8. INERT TANKS WITH DRY ICE. 15-LBS PER 1,000 GAL. MUST MEET A PROPERLY CALIBRATED COMBUSTIBLE GAS METER AND (LEL) RESULTS NOT TO EXCEED 5%.
 9. ALL TANKS TO BE MARKED WITH THE COUNTY PERMIT NUMBER.
 10. SOILS TESTING BY STATE CERTIFIED LABORATORY AS REQUIRED BY CUPA.
 11. DISPOSAL OF (3) UST TANKS BY CERTIFIED HAULER TO PERMITTED RECYCLER AND PROVIDE CERTIFICATE OF DESTRUCTION
 12. BACKFILL AND PLACE CLASS II BASE OVER EXCAVATION
 13. WILL BACKFILL EXCAVATION WITH EXISTING STOCKPILED SOIL
 14. WILL IMPORT CLASS TWO BASE/GRAVEL TO FINISH BACKFILLING
 15. WILL PROVIDE 4" THICK CONCRETE PATCH BACK
 16. PROVIDE CLOSURE REPORT TO OWNER AND THE COUNTY/ CUPA AND FIRE DEPARTMENT

NORTH



YOUR SITE
123 FIRST PLACE
YOUR TOWN

DATE: 01-21-2018	PG. 1
SCALE: AS NOTED	
CGRS, INC.	
5444 DRY CREEK ROAD SACRAMENTO, CA. 95838	