


HIGHWAY

DRIVEWAY

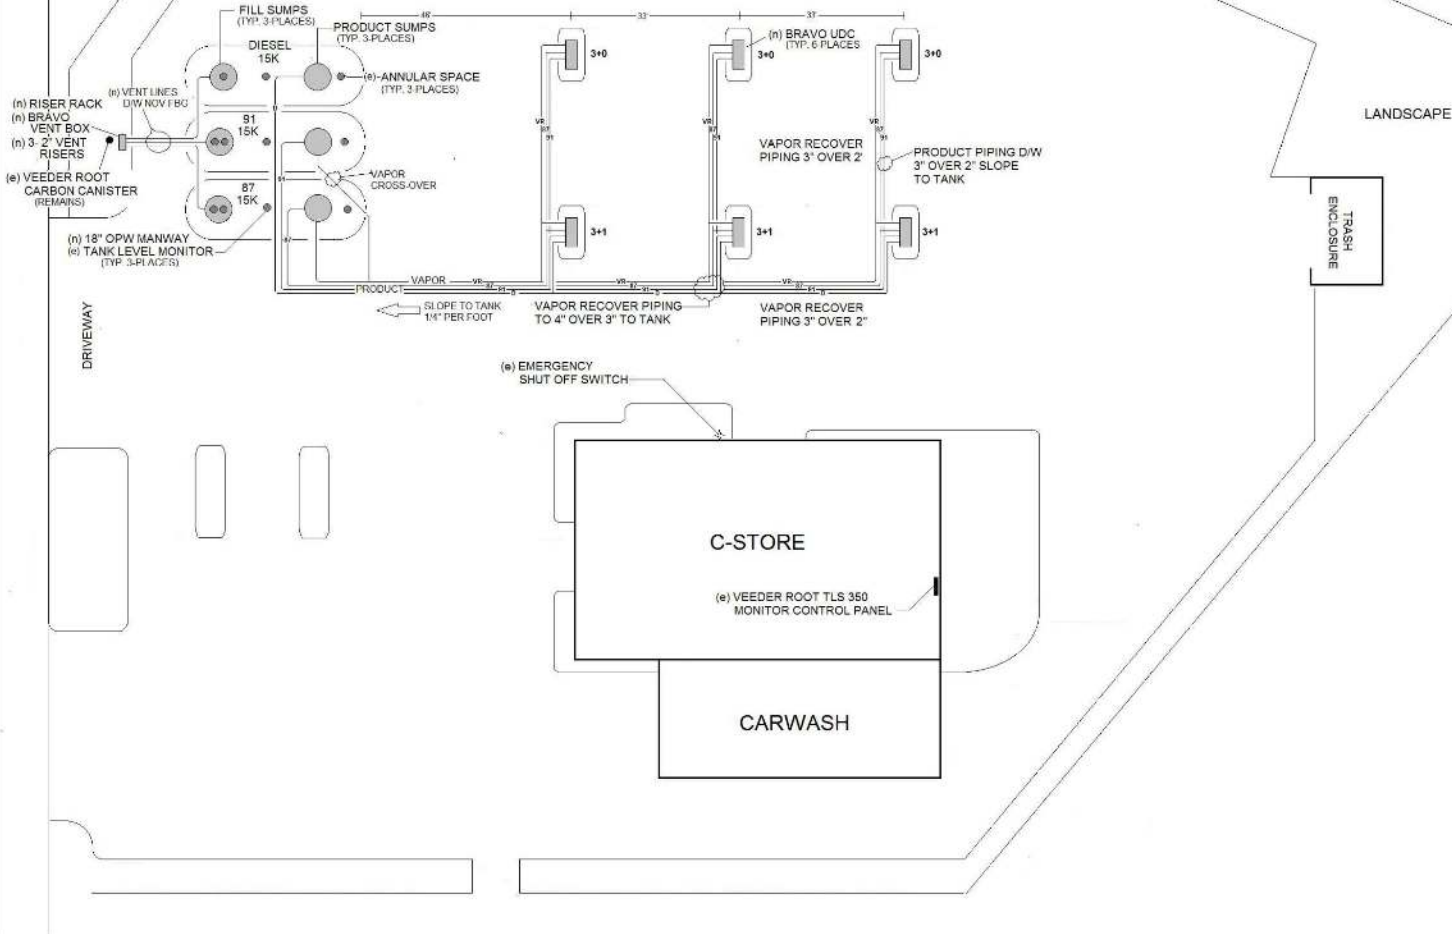


SCOPE OF WORK

- **NEW PRODUCT, VAPOR RECOVERY AND VENT LINES**
 1. EXCAVATE ALL NEW PIPE AND ELECTRICAL TRENCHING
 2. BED EXCAVATED TRENCHES WITH PEA GRAVEL & LEVEL
 3. INSTALL NEW BRAVO "OFFSET" DISPENSER UDC PANS
 4. INSTALL NEW BRAVO VENT BOX
 5. INSTALL SMITH (NOV) PRODUCT PIPING 3" OVER 2" PRODUCT DW PIPE
 6. INSTALL VAPOR RECOVERY PIPING TO REQUIRED SLOPE (NOV) 4" OVER 3" DW PIPE
 7. INSTALL NEW ELECTRICAL CONDUIT TYING INTO EXISTING AND PRE-WIRE FOR DISPENSERS
 8. INSTALL NEW TANK VENT LINES (NOV) 3" OVER 2" DW PIPE
 9. PROVIDE ENHANCED LEAK DETECTION PRETEST
- **INSTALL OF NEW TANKS FILL AND PRODUCT SUMPS**
 1. INSTALL NEW TURBINE AND FILL SUMPS & SEALED MAN WAYS
 2. INSTALL NOV (SMITH) PENETRATION FITTINGS ON SUMPS & UDC'S
 3. INSTALL BRAVO ELECTRICAL PENETRATION FITTINGS ON SUMPS & UDC'S
 4. INSTALL NEW TURBINES, FILL RISERS, AND PIPING INSIDE SUMPS
- **BACKFILL ALL EXCAVATIONS**
 1. BACKFILL ALL EXCAVATIONS TO GRADE WITH PEA GRAVEL
 2. CLEAN SITE FROM RELATED CONSTRUCTION DEBRIS
 3. SET ALL MANWAY & SUMP COVERS TO GRADE FOR CONCRETE
 4. CALL FOR INSPECTIONS AS NECESSARY
- **FORM AND POUR CONCRETE**
 1. ALL CONCRETE TO BE REINFORCED WITH #4 REBAR 18" ON CENTER EACH WAY
 2. FORM AND POUR EXPOSED TANK PAD AREA
 3. FORM AND POUR EXPOSED DISPENSER DRIVE AREA
 4. CALL FOR INSPECTIONS AS NECESSARY
- **FINAL PLUMBING AND ELECTRICAL**
 1. RE-CONNECT WIRING TO DISPENSERS
 2. FINALIZE VEEDER ROOT ISD & UST MONITORING SYSTEM & WIRING
- **FINALIZE PROJECT**
 1. START UP AND TESTING OF EQUIPMENT
 2. PERFORM SB 989 TESTING, MONITORING CERTIFICATION, AND AIR QUALITY TESTING
 3. SUPPLY FINAL INSPECTIONS FROM LOCAL AGENCIES
 4. SUBMIT FINAL REPORTS TO LOCAL AGENCIES.

NOTE.

1. ALL WORK TO BE DONE UNDER THE ICC REPAIR AND INSTALLATION CERTIFICATION.
2. ALL MONITOR SYSTEM MODIFICATIONS SHALL BE ICC TECH CERTIFIED
3. ALL EQUIPMENT AND MATERIAL INSTALLED SHALL BE DONE BY A TRAINED AND CERTIFIED TECH
4. INSPECTIONS SHALL BE SET 72 HOURS IN ADVANCE
5. ALL TEST RESULTS SHALL BE SUBMITTED AT FINAL INSPECTION TIME



YOUR SITE 123 ANY WHERE ANY TOWN, USA	
DATE: 12-20-2017 SCALE: AS NOTED	PG. 1
 CGRS, INC. 5444 DRY CREEK ROAD SACRAMENTO, CA. 95838	